


# TEST REPORT

**REPORT NUMBER**  
181229012SHF-001

**ISSUE DATE**  
2019/1/17

**PAGES**  
6

**DOCUMENT CONTROL NUMBER**  
LFT-APAC-SHF-OP-10k  
© 2018 INTERTEK

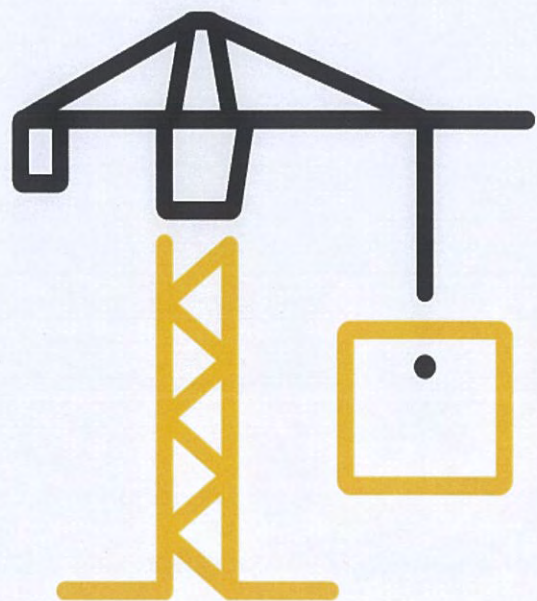

# Test Report

Issue Date: 2019/1/17 Intertek Report No. 181229012SHF-001

Applicant:

Applicant Address:

Attn:

**SUBJECT:** Performance testing  
Wood Plastic Composite

Dear Sir,

This test report represents the results of our evaluation of the above referenced product(s) to the requirements contained in the following standards:

TEST METHODS AND STANDARDS
Refer to the next following Pages.

SAMPLE ID	MODEL	SPECIFICATION
S181229012SHF.001~002	LHMA076	146*23

SAMPLE RECEIVED: 2018/12/29  
TESTED FROM: 2018/12/29 TO 2019/1/17

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

## Test Report

Issue Date: 2019/1/17

Intertek Report No. 181229012SHF-001

### Test Items, Method and Results:

EN 13501-1:2007+A1:2009 Fire classification of construction products and building elements - Part 1: Classification using data from reaction to fire tests

#### 1.1 CRITICAL HEAT FLUX TEST

The test was conducted in accordance with EN ISO 9239-1. This test evaluates the wind-opposed burning behaviour and spread of flame of horizontally mounted floorings exposed to a heat flux radiant gradient in a test chamber, when ignited with pilot flames.

#### 1.2 IGNITABILITY TEST

The test was conducted in accordance with EN ISO 11925-2. This test evaluates the ignitability of a product under exposure to a small flame.

#### 1.3 CLASSIFICATION CRITERIA

The classification was determined in accordance with EN 13501-1:2007+A1:2009. The class B<sub>fl</sub> with its corresponding fire performance is given in the table below.

Table - Classes of reaction to fire performance for flooring.

Class	Test Method(s)	Classification criteria	Additional classifications
B <sub>fl</sub>	EN ISO 9239-1 <sup>a</sup> and	Critical flux <sup>b</sup> ≥ 8.0 kW/m <sup>2</sup>	Smoke production <sup>c</sup>
	EN ISO 11925-2 <sup>d</sup> Exposure = 15 s	F <sub>s</sub> ≤ 150 mm within 20 s	-

#### Note:

a. Test duration = 30 min.

b. Critical flux is defined as the radiant flux at which the flame extinguishes or the radiant flux after a test period of 30 min, whichever is the lower (i.e. the flux corresponding with the furthest extent of spread of flame).

c. s1 = Smoke ≤ 750 % minutes; s2 = not s1.

d. Under conditions of surface flame attack and, if appropriate to the end use application of the product, edge flame attack.

# Test Report

Issue Date: 2019/1/17

Intertek Report No. 181229012SHF-001

## Test Items, Method and Results:

### 2 RESULTS AND OBSERATIONS

Method	Parameter	Result
EN ISO 9239-1:2010	Critical flux (transverse), kW/m <sup>2</sup>	≥ 11.0
	Critical flux (longitudinal), kW/m <sup>2</sup>	≥ 11.0
	Smoke production, % minutes	138
EN ISO 11925-2:2010 Exposure = 15 s	F <sub>s</sub> ≤ 150 mm within 20 s	Yes

### 3 CLASSIFICATION

The classification has been carried out in accordance with EN 13501-1.

Fire behaviour		Smoke production	
<i>B<sub>fl</sub></i>	-	s	1

Reaction to fire classification: *B<sub>fl</sub>-s1*

## Test Report


Issue Date: 2019/1/17

Intertek Report No. 181229012SHF-001

### 4 Test Photos of EN ISO 9239-1



Before test

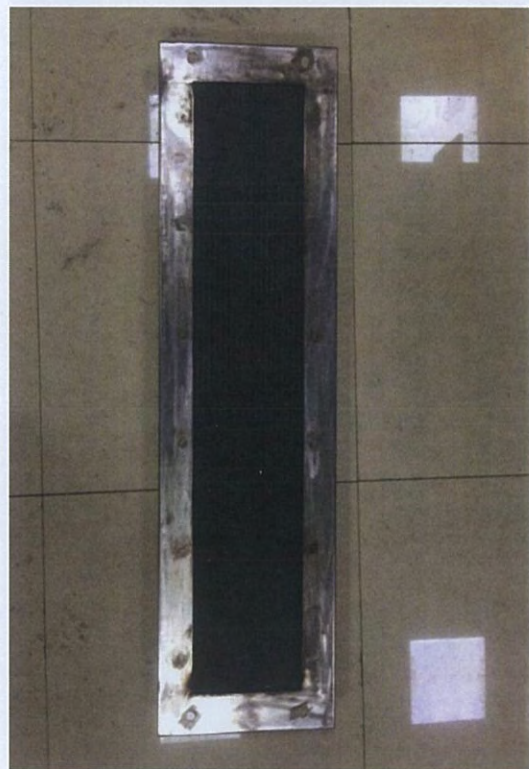


After test

## Test Report


Issue Date: 2019/1/17

Intertek Report No. 181229012SHF-001

### APPENDIX: SAMPLE RECEIVED PHOTO

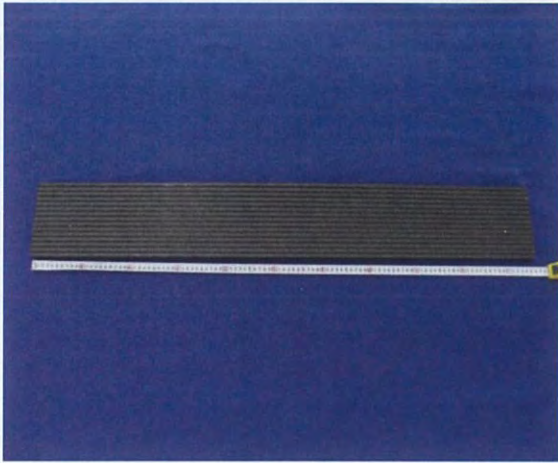

Front View (Test Face)

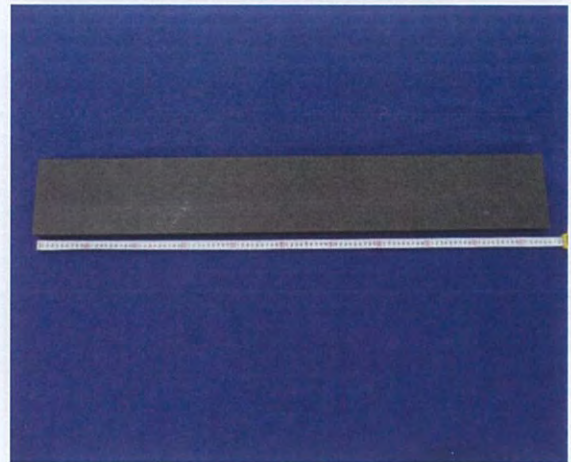

Back View

### REPORT AUTHORIZED

When signed with physical or electronic signature, the contents of this report have been prepared and approved per Intertek's quality process in accordance with ISO 17025.

*Sally Xie*

Name: Sally Xie

Title: Reviewer



*Tod Qian*

Name: Tod Qian

Title: Project Engineer

### Revision:

NO.	DATE	CHANGES	AUTHOR	REVIEWER
181229012SHF-001	2019/1/17	First issue	Tod Qian	Sally Xie